


1.6 Grounding/Shielding of several GMM-GCM Modbus devices

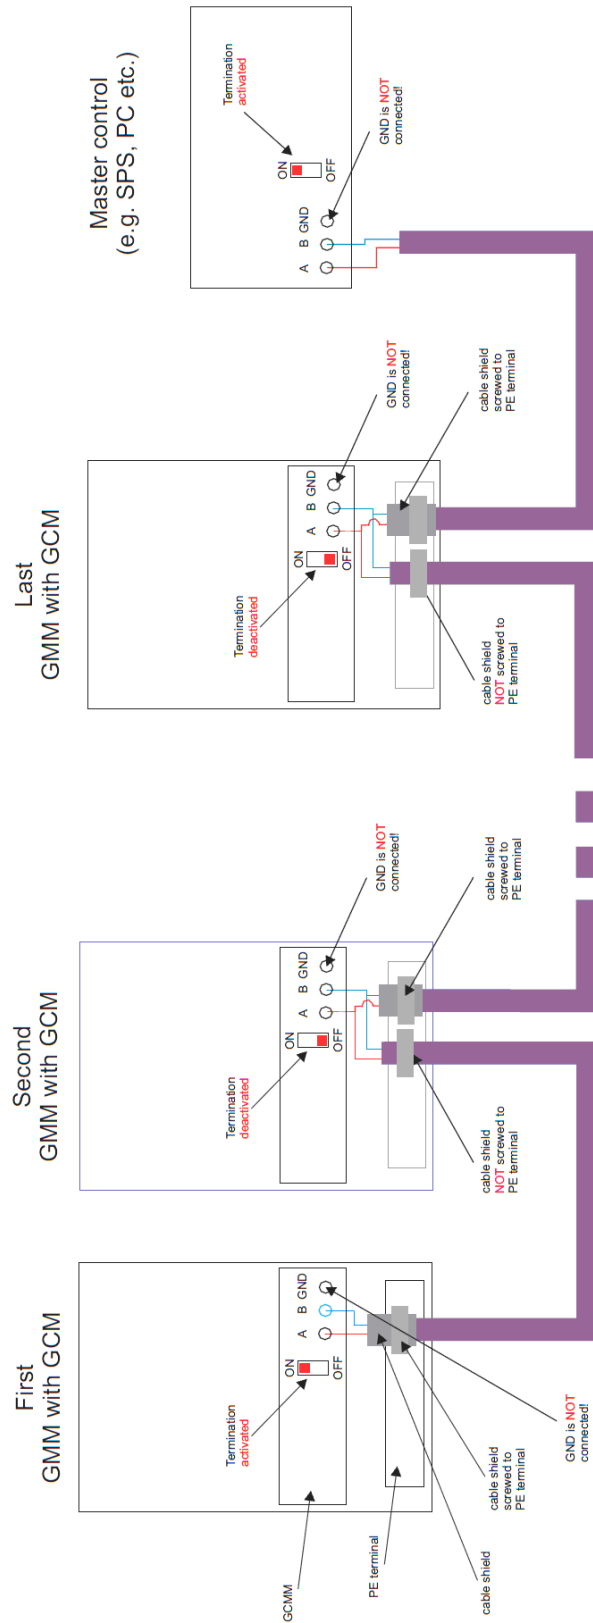

Note: Only one connection of the cable shield of each bus cable to the PE terminal is allowed (there also should not be a connection to the PE terminal of the master control)

Possible cable types:

all two wire bus cables which are designed for RS485 bus communication